



NOTES:  
REFER TO EQUIPMENT ANCHORAGE SCHEDULE BELOW

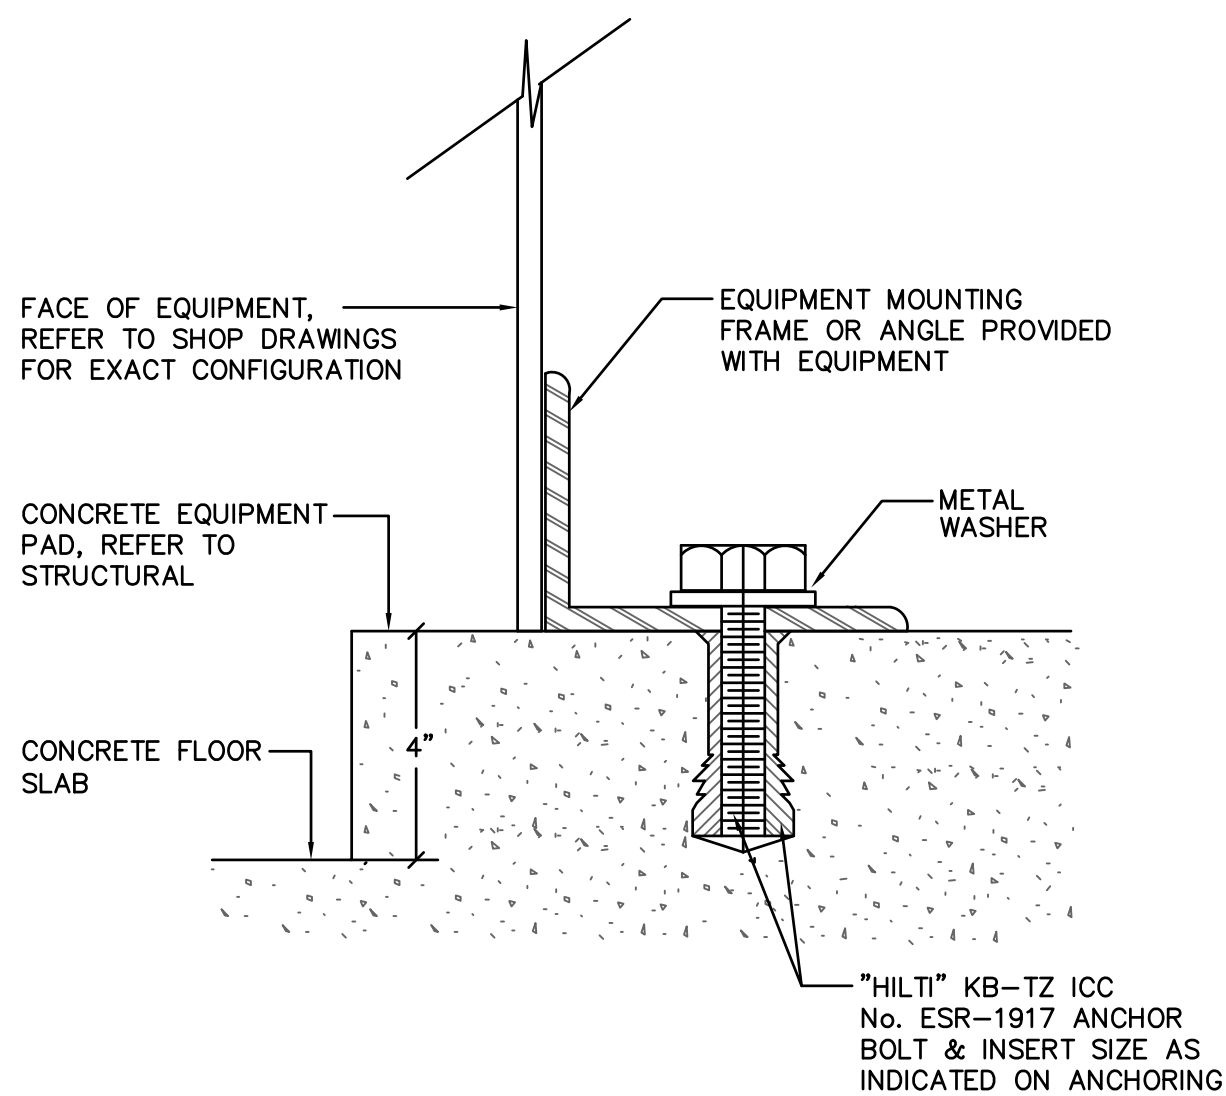

NOTES:  
REFER TO EQUIPMENT ANCHORAGE SCHEDULE BELOW

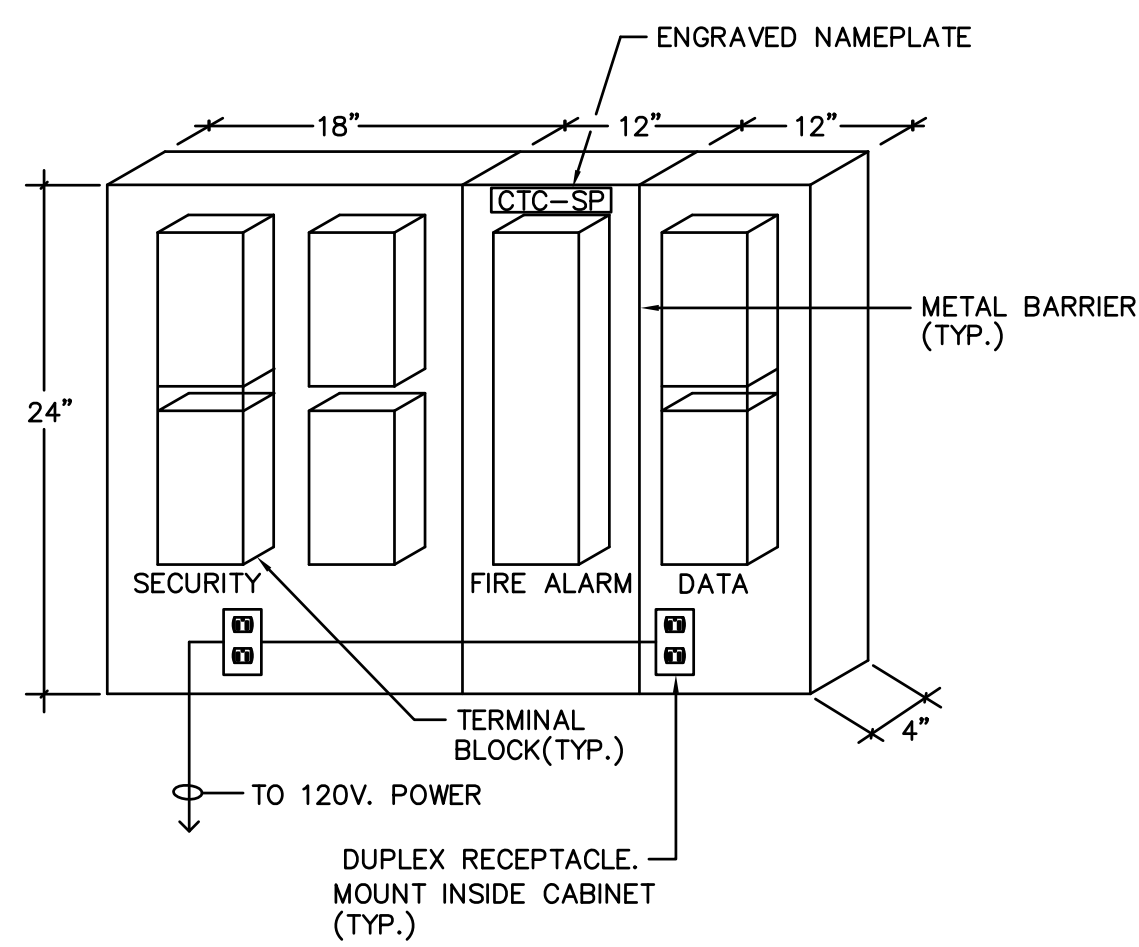

NOTES:  
1. EACH SECTION SHALL HAVE AN INDIVIDUAL HINGED DOOR WITH FLUSH LOCK.  
2. PROVIDE PLYWOOD BACKBOARD AND TERMINAL BLOCK(S) IN EACH SECTION AS REQUIRED.  
3. PROVIDE ENGRAVED NAMEPLATES FOR CABINETS AND ALL SECTIONS, REFER TO DRAWINGS FOR DESIGNATIONS.

DISTRIBUTION PANEL MOUNTING DETAIL

NOT TO SCALE 1


DISTRIBUTION PANEL ANCHORING DETAIL

NOT TO SCALE 2


COMMUNICATION TERMINAL CABINET DETAIL

NOT TO SCALE 3

SYMBOL	H	W	D	WEIGHT	MIN. NO ANCHORS	SIZE OF ANCHORS	MINIMUM EMBEDMENT
TR-SP	68"	45"	36"	3600	4	1/2" #	2"
DP-SP	90"	36"	37"	1200	6	1/2" #	2"

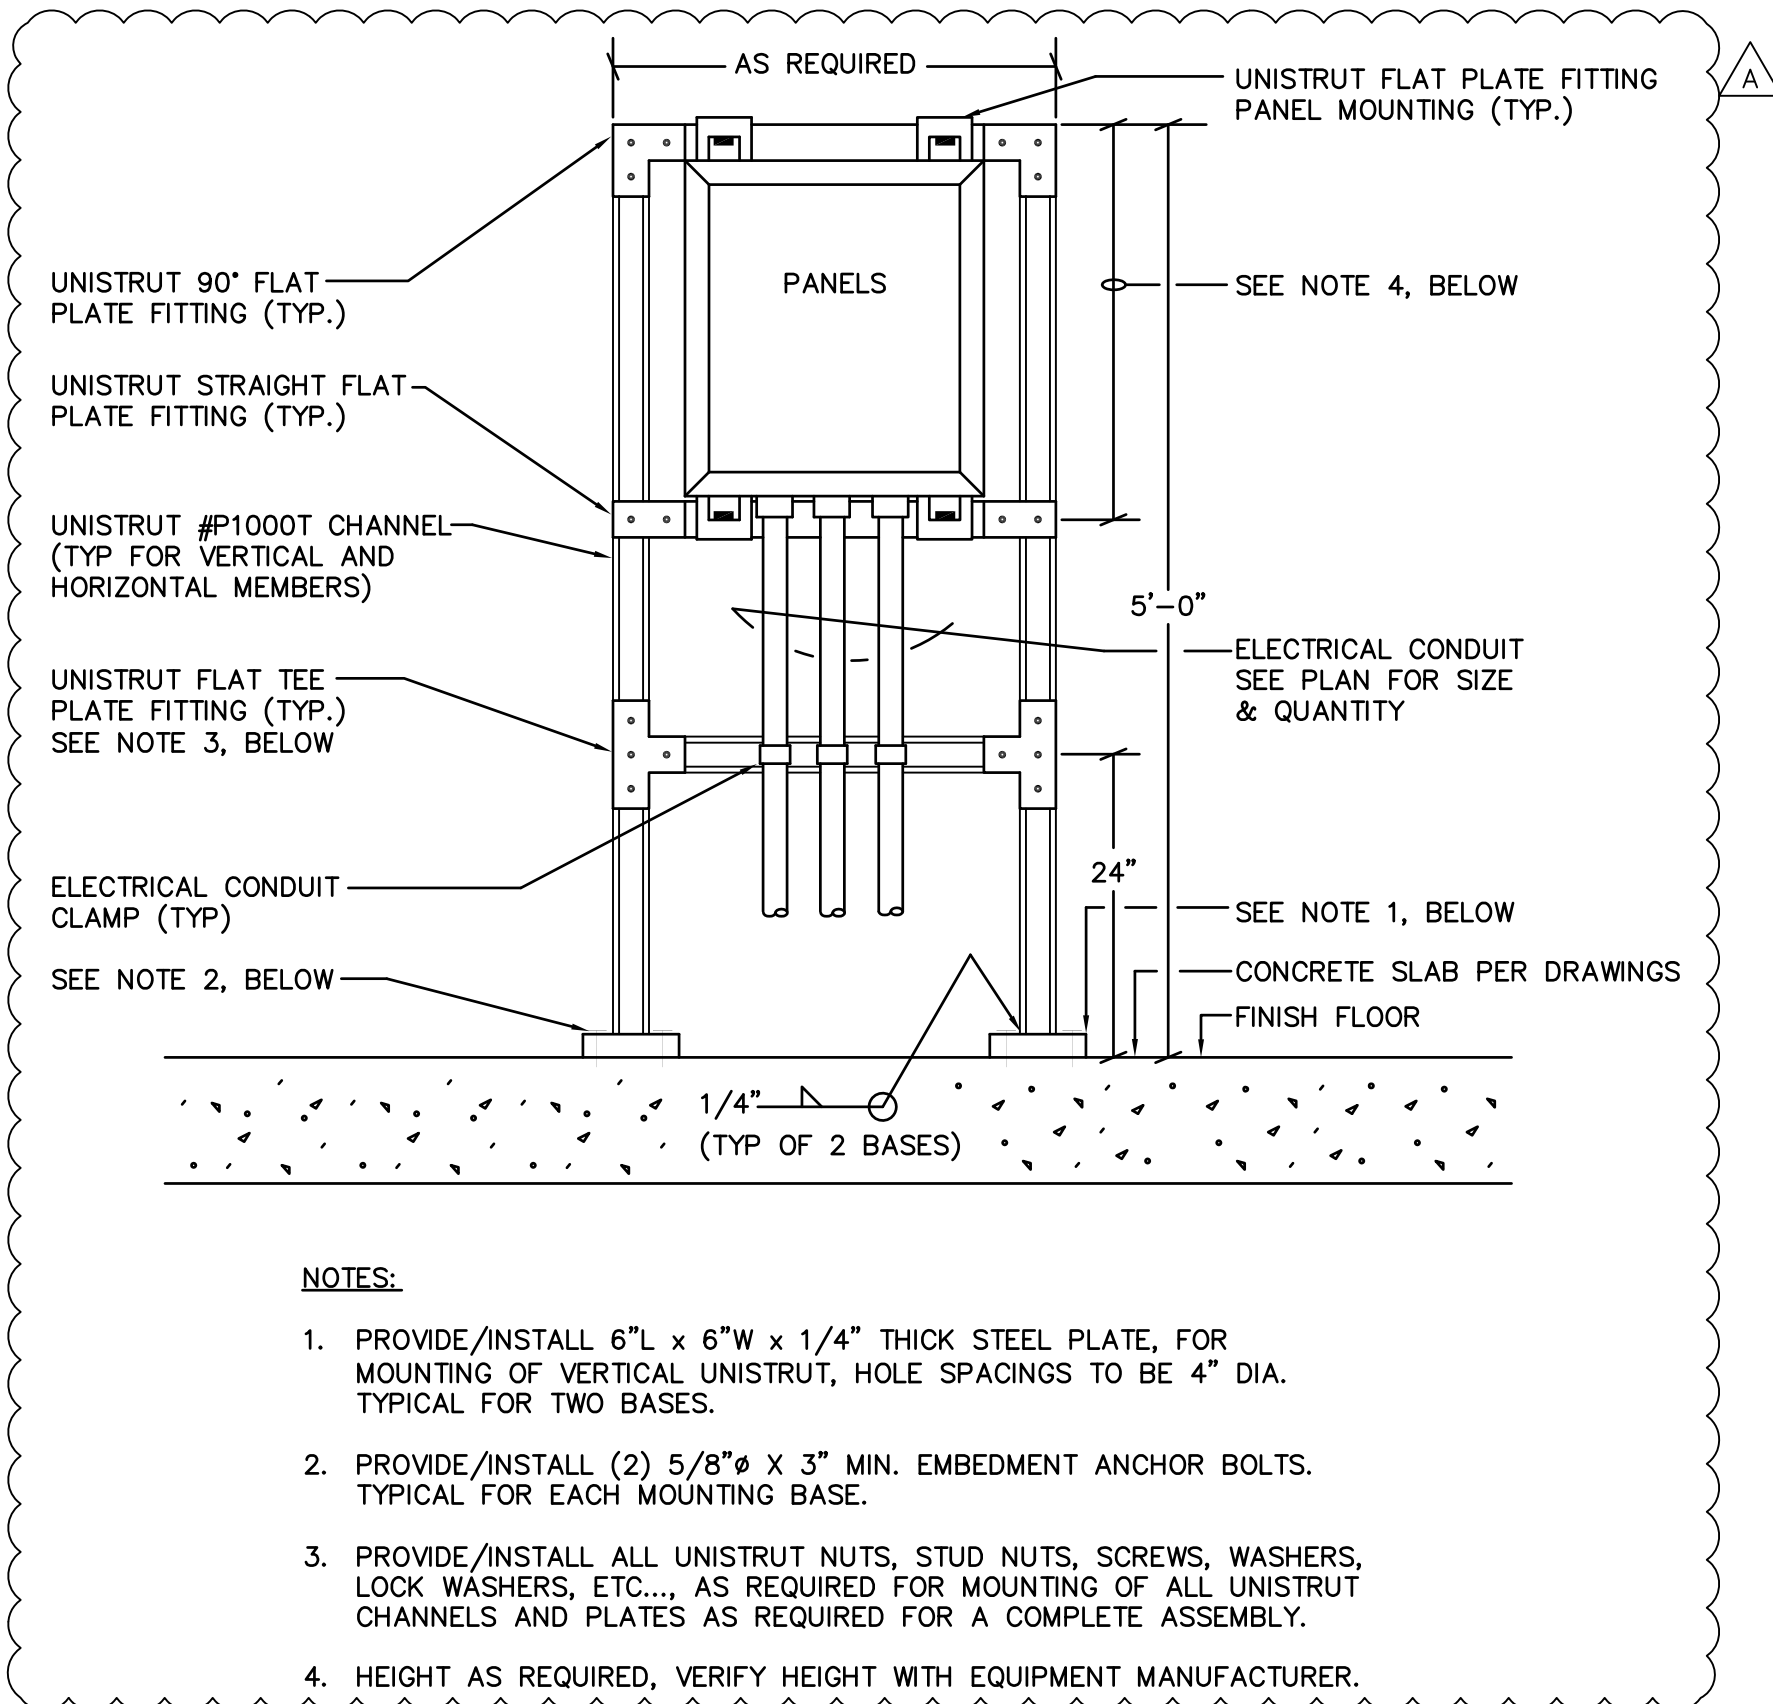

NOTES:  
1. PROVIDE/INSTALL 6"L x 6"W x 1/4" THICK STEEL PLATE, FOR MOUNTING OF VERTICAL UNISTRUT, HOLE SPACINGS TO BE 4" DIA. TYPICAL FOR TWO BASES.  
2. PROVIDE/INSTALL (2) 5/8" x 3" MIN. EMBEDMENT ANCHOR BOLTS, TYPICAL FOR EACH MOUNTING BASE.  
3. PROVIDE/INSTALL ALL UNISTRUT NUTS, STUD NUTS, SCREWS, WASHERS, LOCK WASHERS, ETC., AS REQUIRED FOR MOUNTING OF ALL UNISTRUT CHANNELS AND PLATES AS REQUIRED FOR A COMPLETE ASSEMBLY.  
4. HEIGHT AS REQUIRED, VERIFY HEIGHT WITH EQUIPMENT MANUFACTURER.

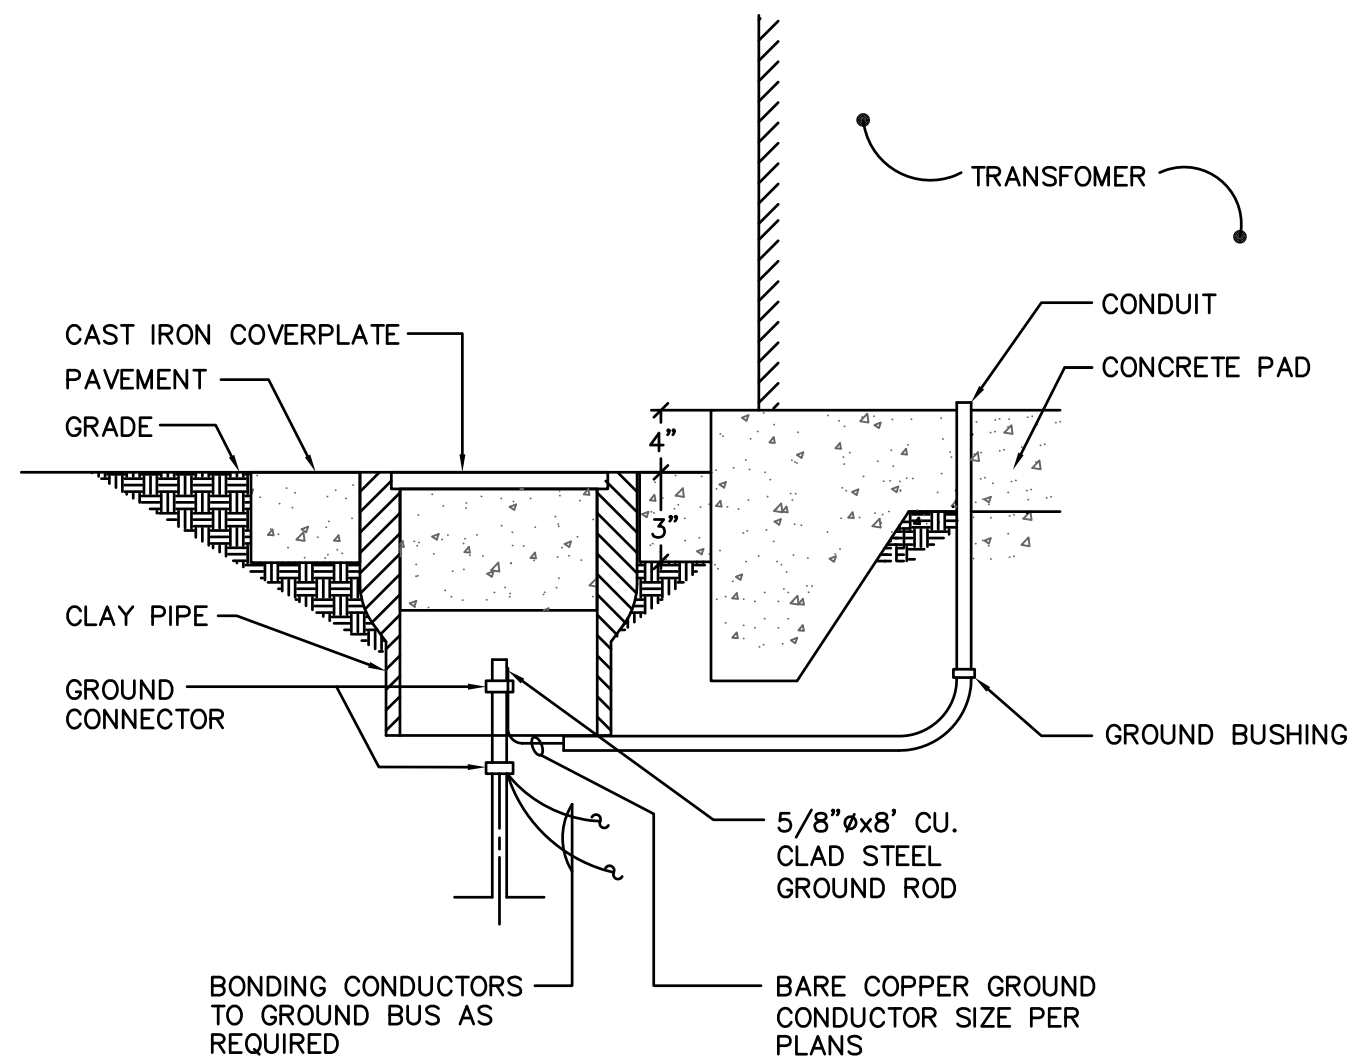

EQUIPMENT ANCHORAGE SCHEDULE


NOT TO SCALE 4

TYPICAL PANEL MOUNTING DETAIL

NOT TO SCALE 5


GROUND WELL DETAIL

NOT TO SCALE 6

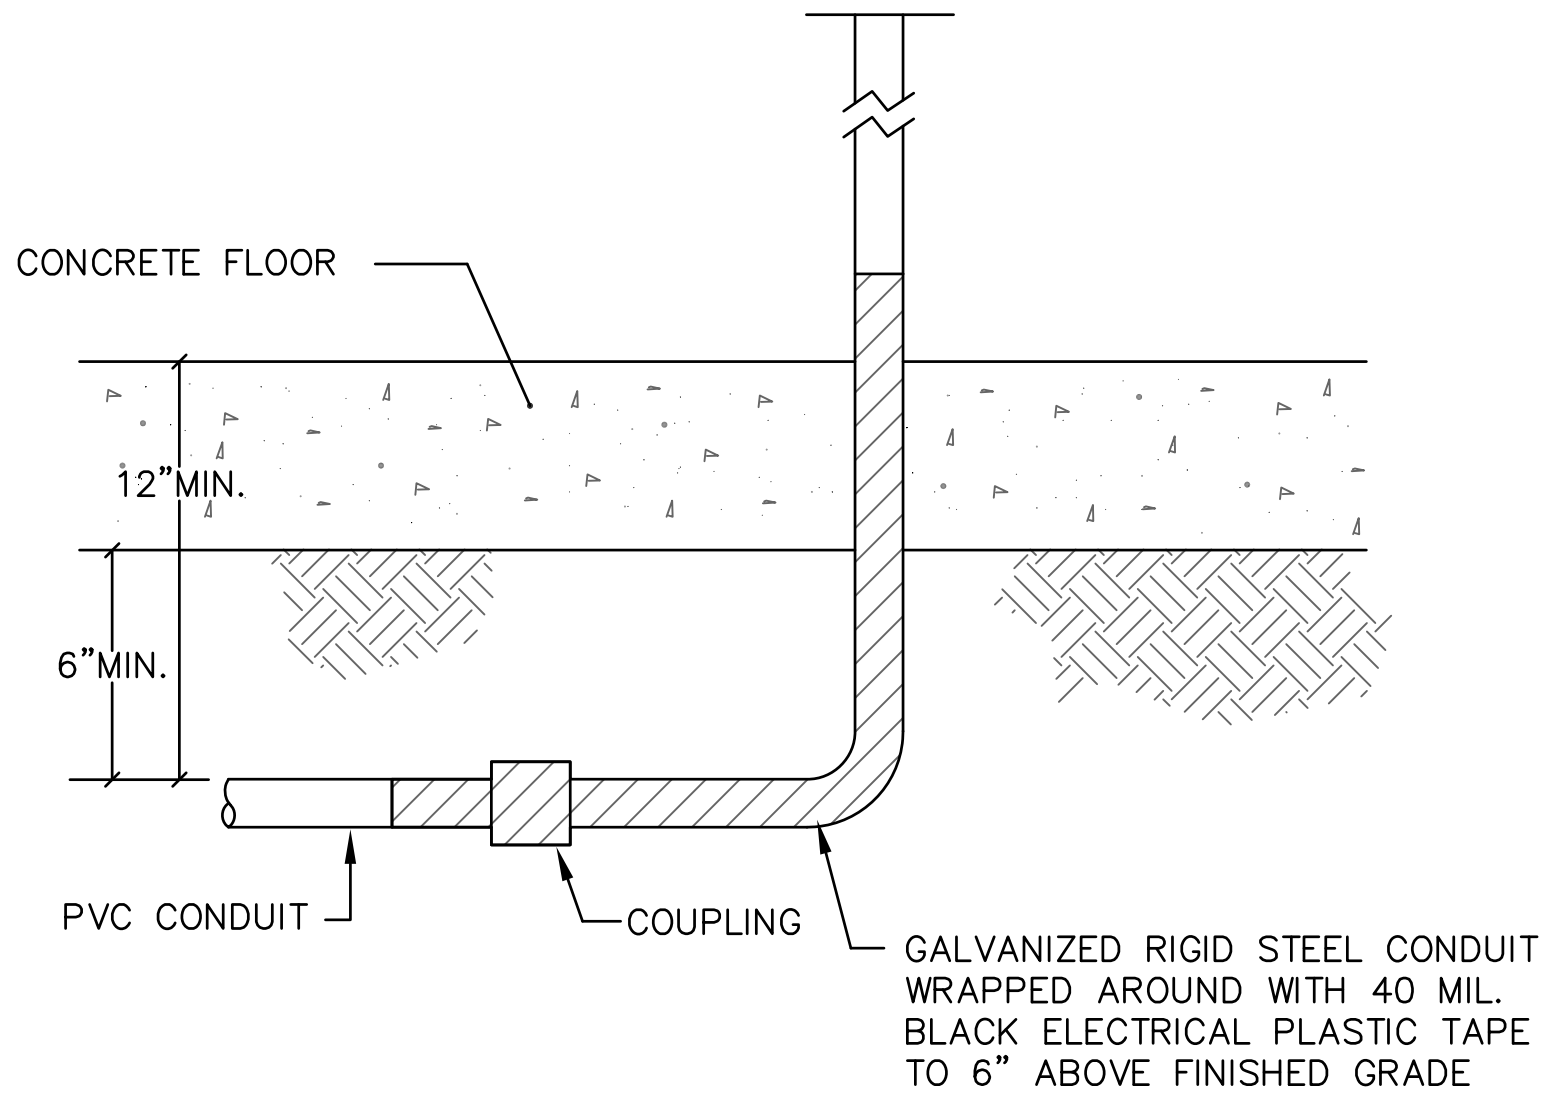


CONDUIT INSTALLED BELOW CONCRETE INSIDE BUILDING DETAIL

NOT TO SCALE 7

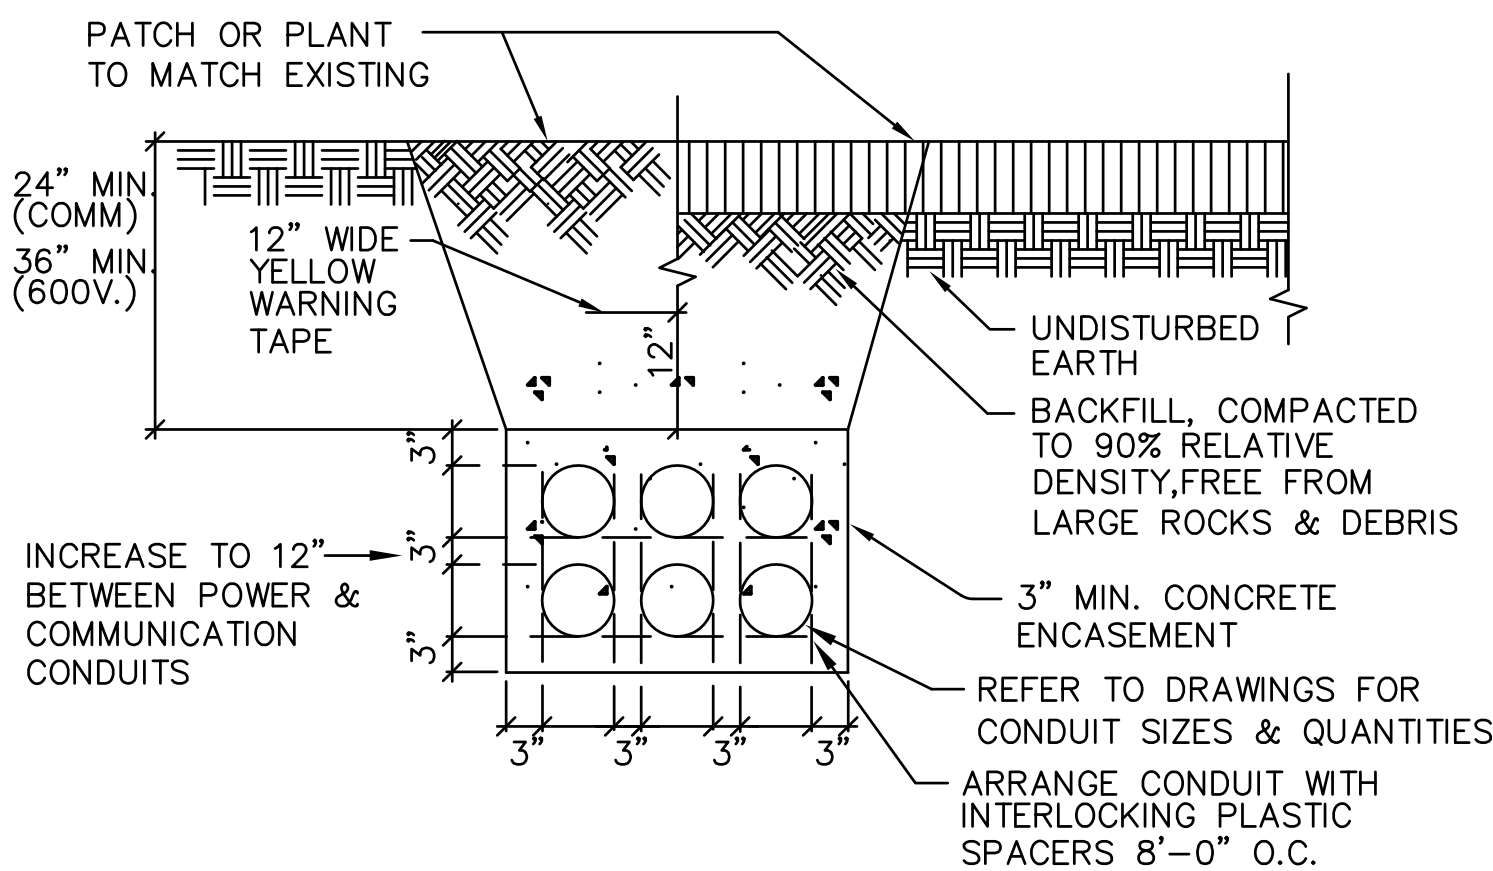


UNDERGROUND MULTI-CONDUIT PLACEMENT DETAIL

NOT TO SCALE 8

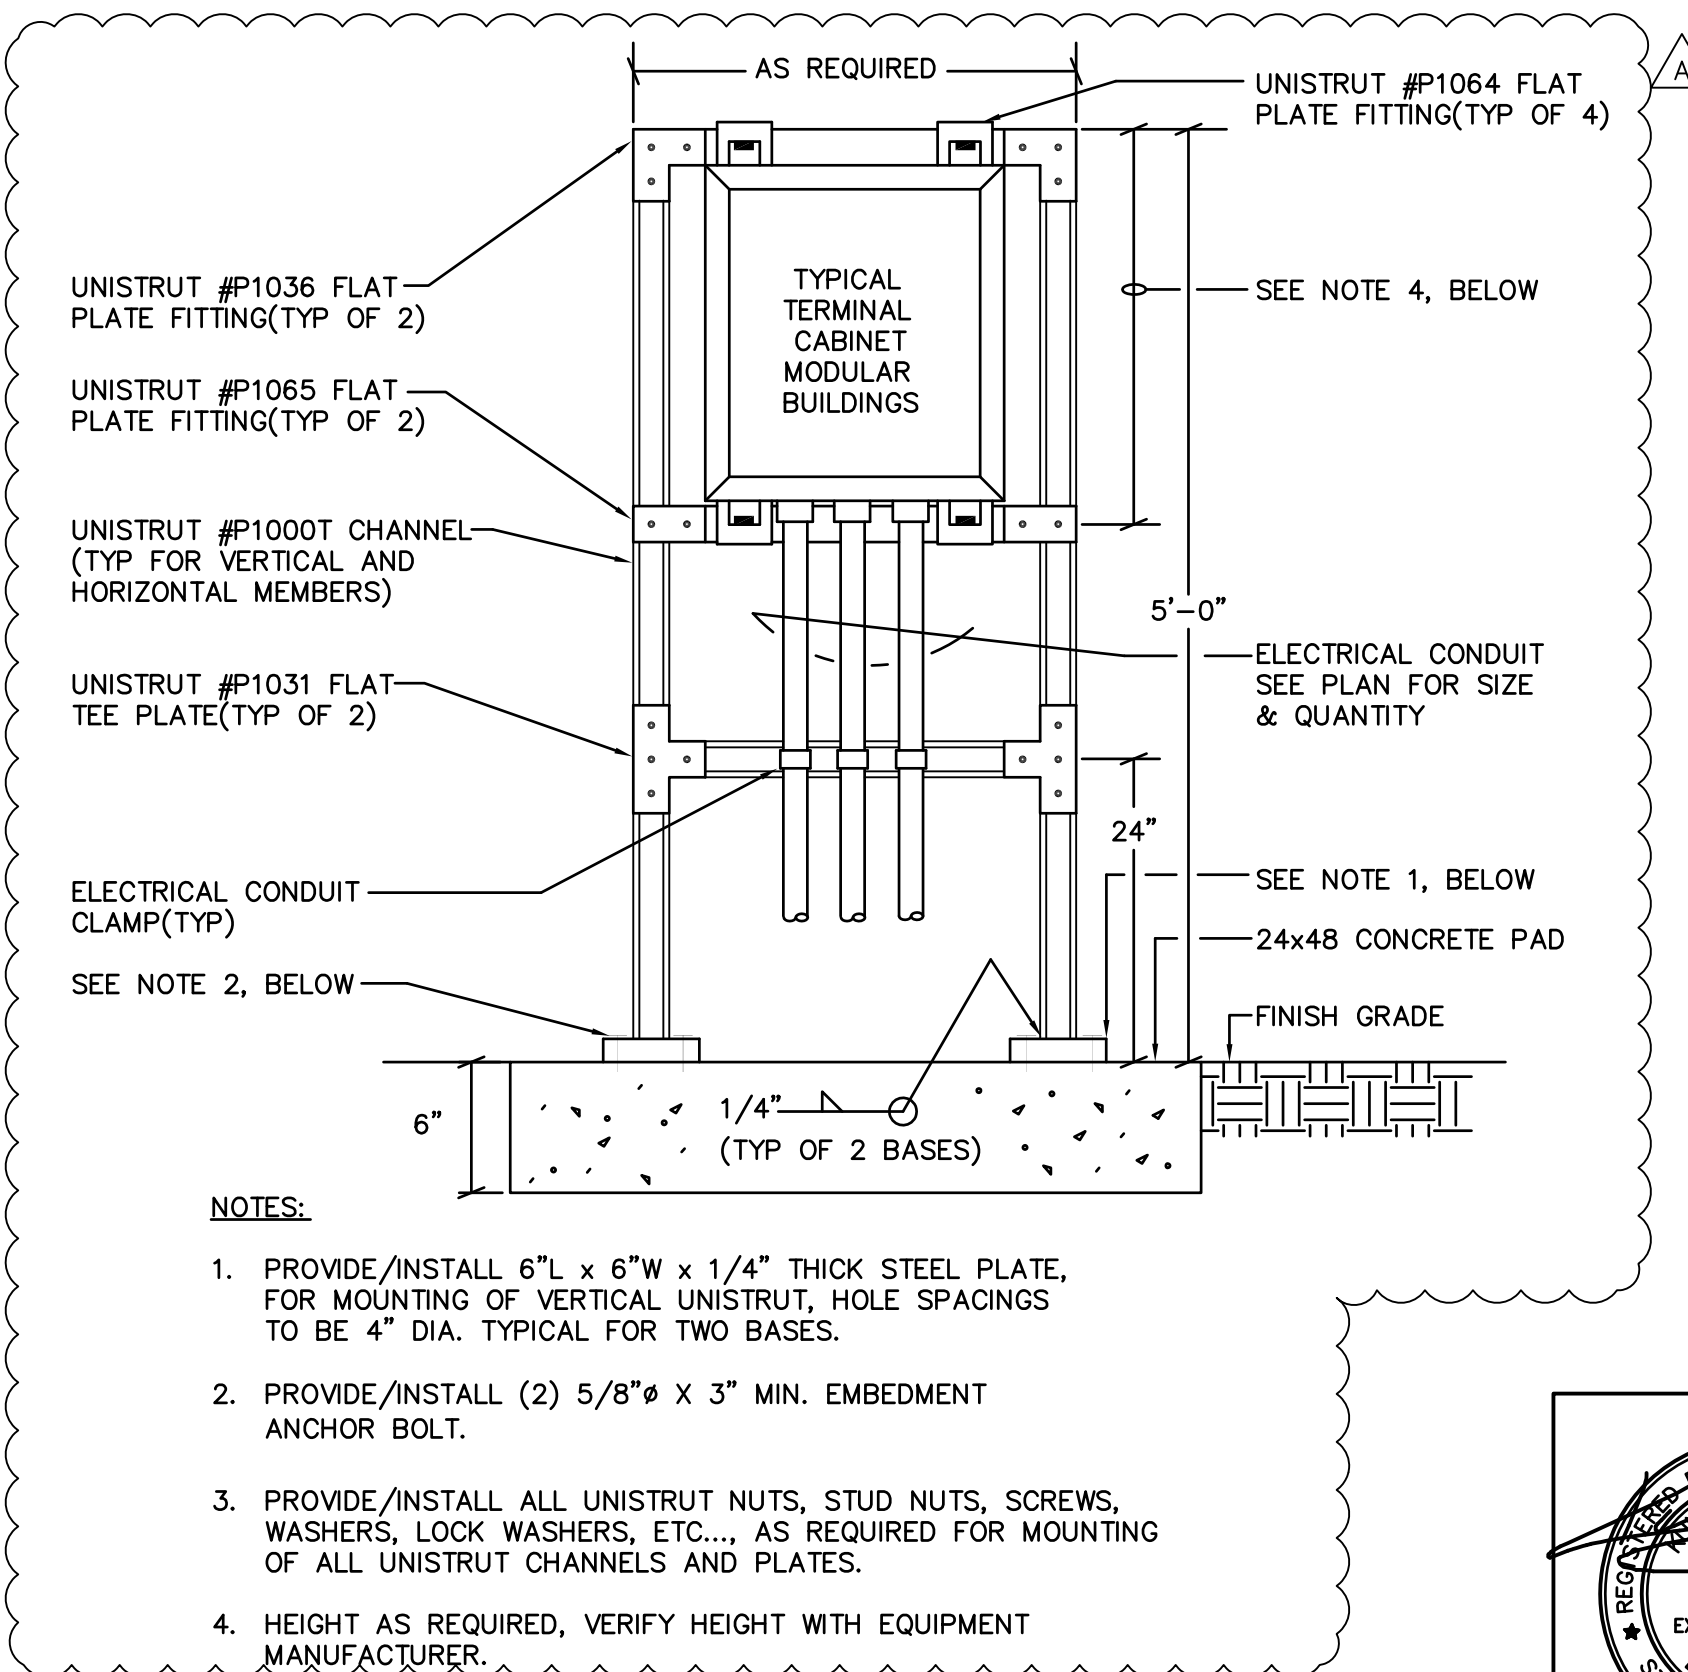

NOTES:  
1. PROVIDE/INSTALL 6"L x 6"W x 1/4" THICK STEEL PLATE, FOR MOUNTING OF VERTICAL UNISTRUT, HOLE SPACINGS TO BE 4" DIA. TYPICAL FOR TWO BASES.  
2. PROVIDE/INSTALL (2) 5/8" x 3" MIN. EMBEDMENT ANCHOR BOLT.  
3. PROVIDE/INSTALL ALL UNISTRUT NUTS, STUD NUTS, SCREWS, WASHERS, LOCK WASHERS, ETC., AS REQUIRED FOR MOUNTING OF ALL UNISTRUT CHANNELS AND PLATES.  
4. HEIGHT AS REQUIRED, VERIFY HEIGHT WITH EQUIPMENT MANUFACTURER.

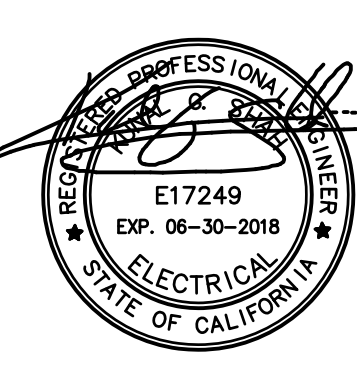


TERMINAL CABINET MOUNTING DETAIL

NOT TO SCALE 9

OWNER: EL MONTE UNION HIGH SCHOOL DISTRICT

PROJECT NAME: EL MONTE HIGH SCHOOL BLEACHERS

CLIENT ADDRESS: 3048 TYLER AVENUE, EL MONTE, CA, 91731

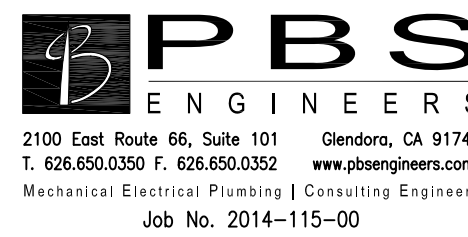

IDENTIFICATION STAMP  
DIVISION OF THE STATE ARCHITECT  
OFFICE OF REGULATION SERVICES

A# 03-117117

AC \_\_\_\_\_ FLS \_\_\_\_\_ SS \_\_\_\_\_

DATE \_\_\_\_\_

FILE# 19-H10

REVISIONS:	DESCRIPTION	DATE
▲	Addendum A	4-5-2017
▲		
▲		
▲		
▲		
▲		
▲		
▲		
▲		
▲		

DATE ISSUED: 01-23-2017

PROJECT NO: 2014-40163

SCALE: AS SHOWN

SHEET NUMBER: E401

SHEET TITLE:

DETAILS



THIS DOCUMENT CONTAINS INFORMATION PROPRIETARY TO SVA ARCHITECTS INC. AND IS FURNISHED IN CONFIDENCE FOR THE LIMITED PURPOSE OF EVALUATION, RECORD OR REVIEW. THIS DOCUMENT OR ITS CONTENTS MAY NOT BE USED FOR ANY OTHER PURPOSE AND MAY NOT BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF SVA ARCHITECTS INC. ALL RIGHTS RESERVED. © COPYRIGHT 2014.